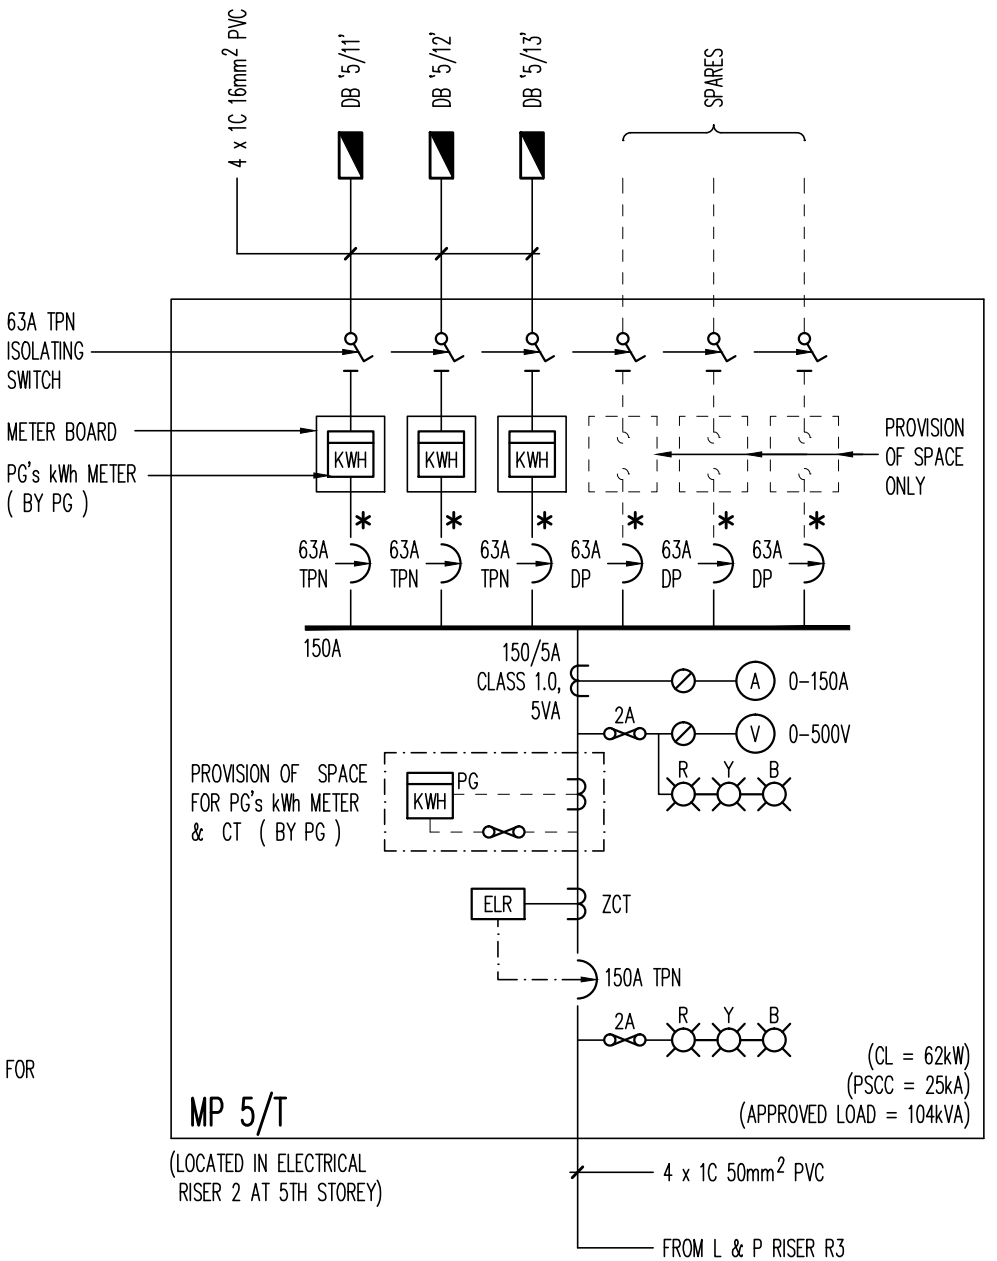


NOTE:

1. MCB MARKED WITH AN ASTERISK (*) DENOTES MIN. M6 TYPE C SEALABLE AT 'OFF' POSITION TO PSL'S APPROVAL.

2. INCOMING MCCB SHALL BE TESTED FOR DIRECT ACTING (D/A) TRIP TO OPERATE THE MCCB'S SHUNT TRIP INSTANTANEOUSLY DURING A SHORT CIRCUIT CONDITION TO PSL'S REQUIREMENT. IF D/A TRIP TEST FAILS, HRC FUSE OF SAME CURRENT RATING AS THE MCCB SHALL BE PROVIDED BEFORE THE MCCB. } ONLY APPLICABLE FOR TENANCY WORKS

Drg Title	Drg No.	
TYPICAL METERING PANEL (FOR MULTI TENANTS)	SE(SL) - 2A	Alpha Consulting Engineers Pte Ltd

SESLA-02.dwg