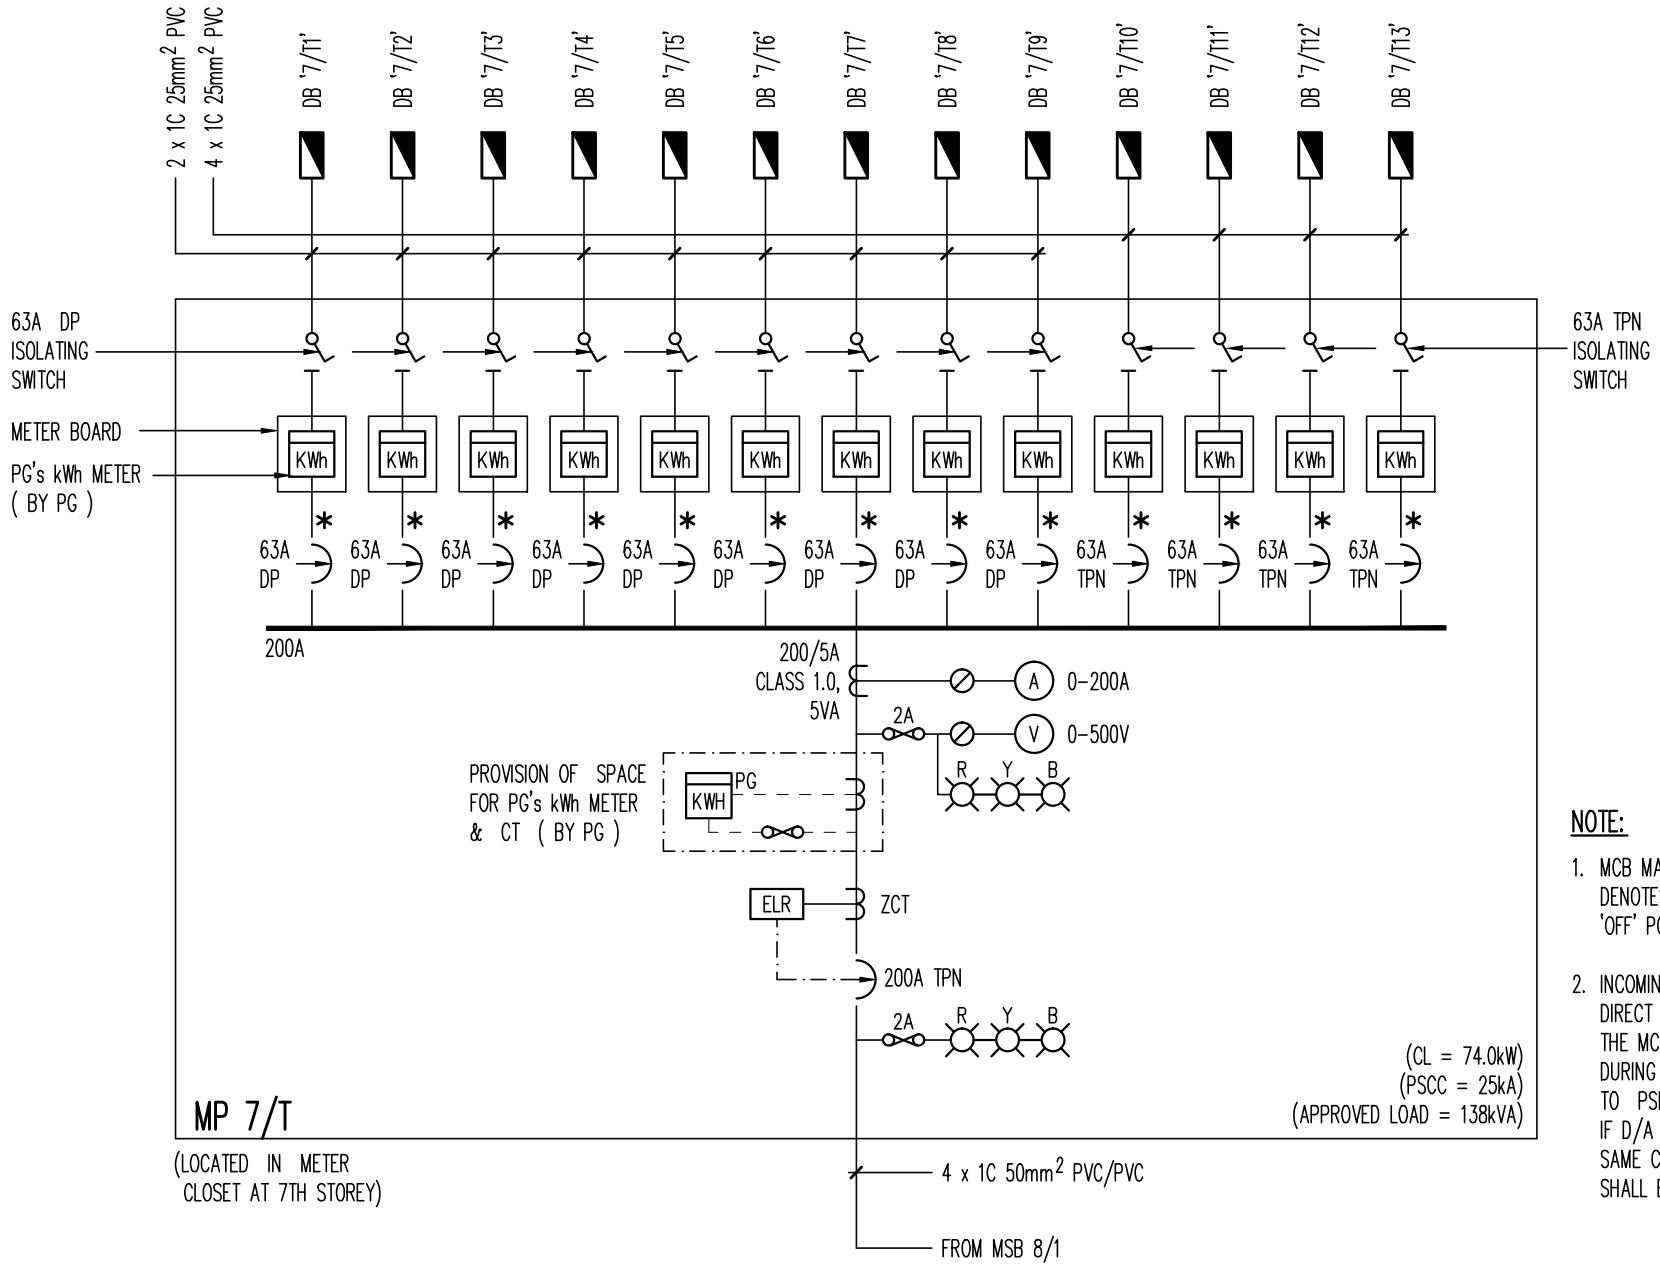


NOTE:

1. MCB MARKED WITH AN ASTERISK (*) DENOTES MIN. M6 TYPE C SEALABLE AT 'OFF' POSITION TO PSL'S APPROVAL.

2. INCOMING MCCB SHALL BE TESTED FOR DIRECT ACTING (D/A) TRIP TO OPERATE THE MCCB'S SHUNT TRIP INSTANTANEOUSLY DURING A SHORT CIRCUIT CONDITION TO PSL'S REQUIREMENT.
   IF D/A TRIP TEST FAILS, HRC FUSE OF SAME CURRENT RATING AS THE MCCB SHALL BE PROVIDED BEFORE THE MCCB.

   ONLY APPLICABLE FOR TENANCY WORKS

Drg Title	Drg No.	
TYPICAL METERING PANEL (FOR MULTI TENANTS)	SE(SL) - 3A	Alpha Consulting Engineers Pte Ltd

SESLA-03.dwg