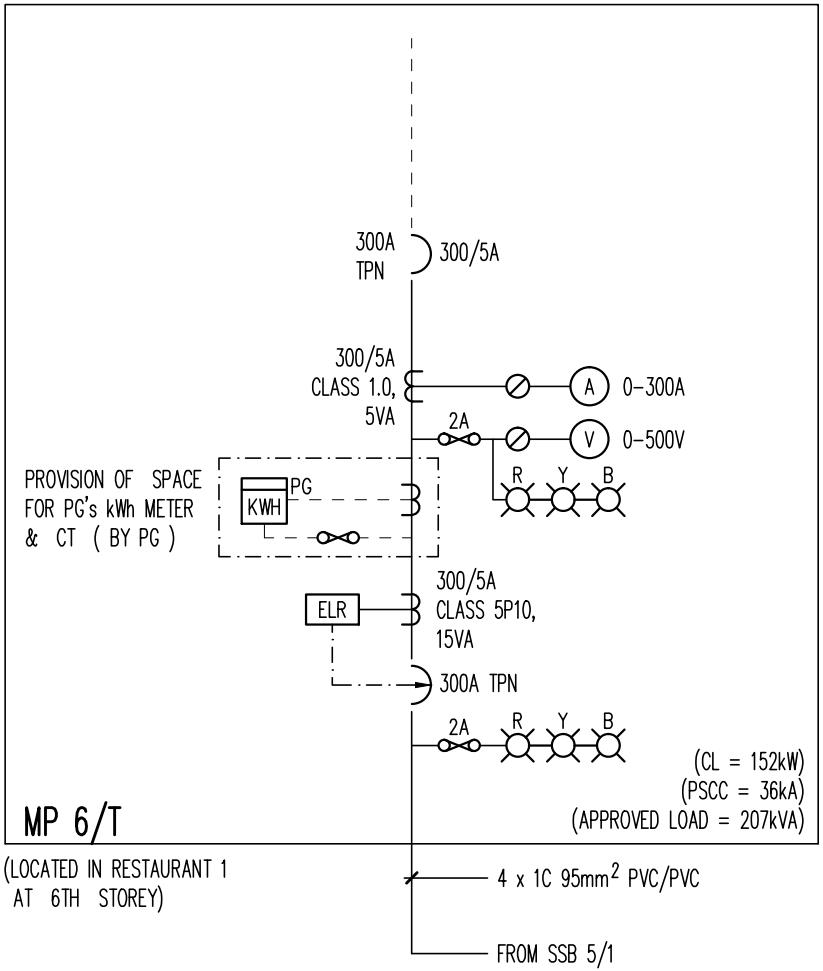


NOTE:

INCOMING MCCB SHALL BE TESTED FOR DIRECT ACTING (D/A) TRIP TO OPERATE THE MCCB'S SHUNT TRIP INSTANTANEOUSLY DURING A SHORT CIRCUIT CONDITION TO PSL'S REQUIREMENT.
IF D/A TRIP TEST FAILS, HRC FUSE OF SAME CURRENT RATING AS THE MCCB SHALL BE PROVIDED BEFORE THE MCCB.

} ONLY APPLICABLE FOR TENANCY WORKS

Drg Title	Drg No.	
TYPICAL METERING PANEL (FOR SINGLE TENANT)	SE(SL) - 4A	Alpha Consulting Engineers Pte Ltd

SESLA-04.dwg