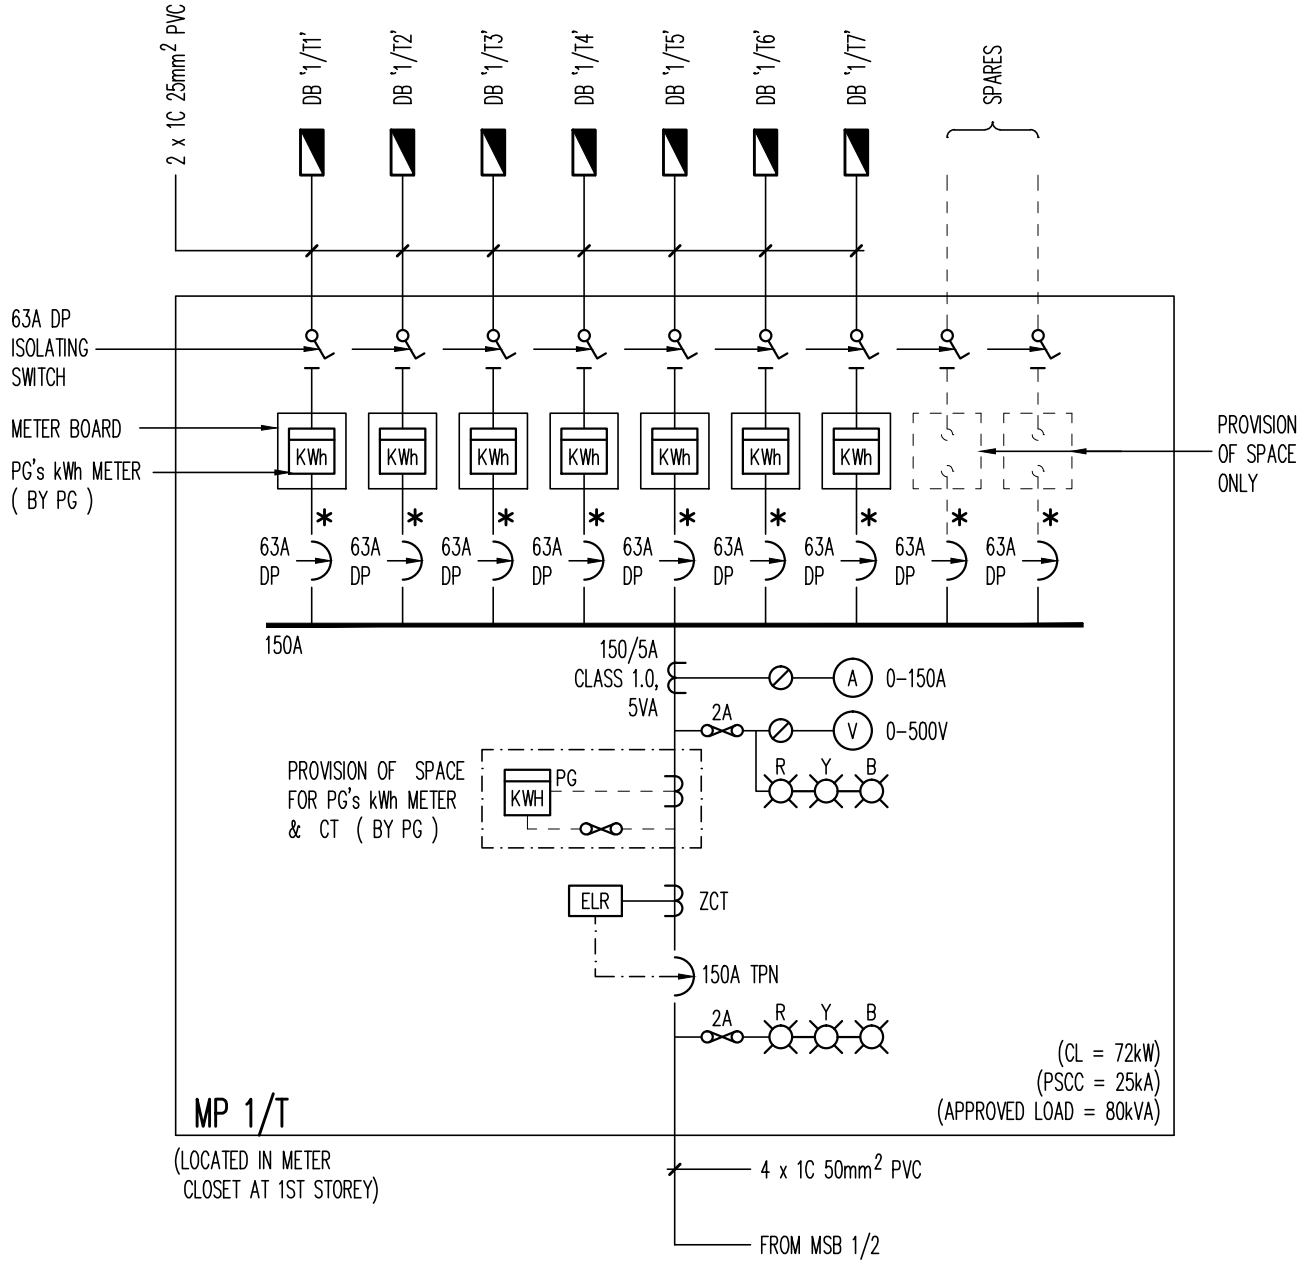


NOTE:

1. MCB MARKED WITH AN ASTERISK (*) DENOTES MIN. M6 TYPE C SEALABLE AT 'OFF' POSITION TO PSL'S APPROVAL.

Drg Title	Drg No.	
TYPICAL METERING PANEL (FOR MULTI TENANTS)	SE(SL) - 5A	Alpha Consulting Engineers Pte Ltd

SESLA-05.dwg