
NOTE

EACH EARTH POINT COMPRISING A COMBINATION OF EARTH ELECTRODE AND EARTH PLATE FOR ELECTRICAL & COMMUNICATION EARTHING SHALL ACHIEVE AN EARTH RESISTANCE VALUE OF ONE (1) OHM OR LESS, OR AS APPROVED ELSEWHERE. ADDITIONAL EARTH POINTS SHALL BE PROVIDED IF NECESSARY TO ACHIEVE THE REQUIRED EARTH RESISTANCE VALUE.

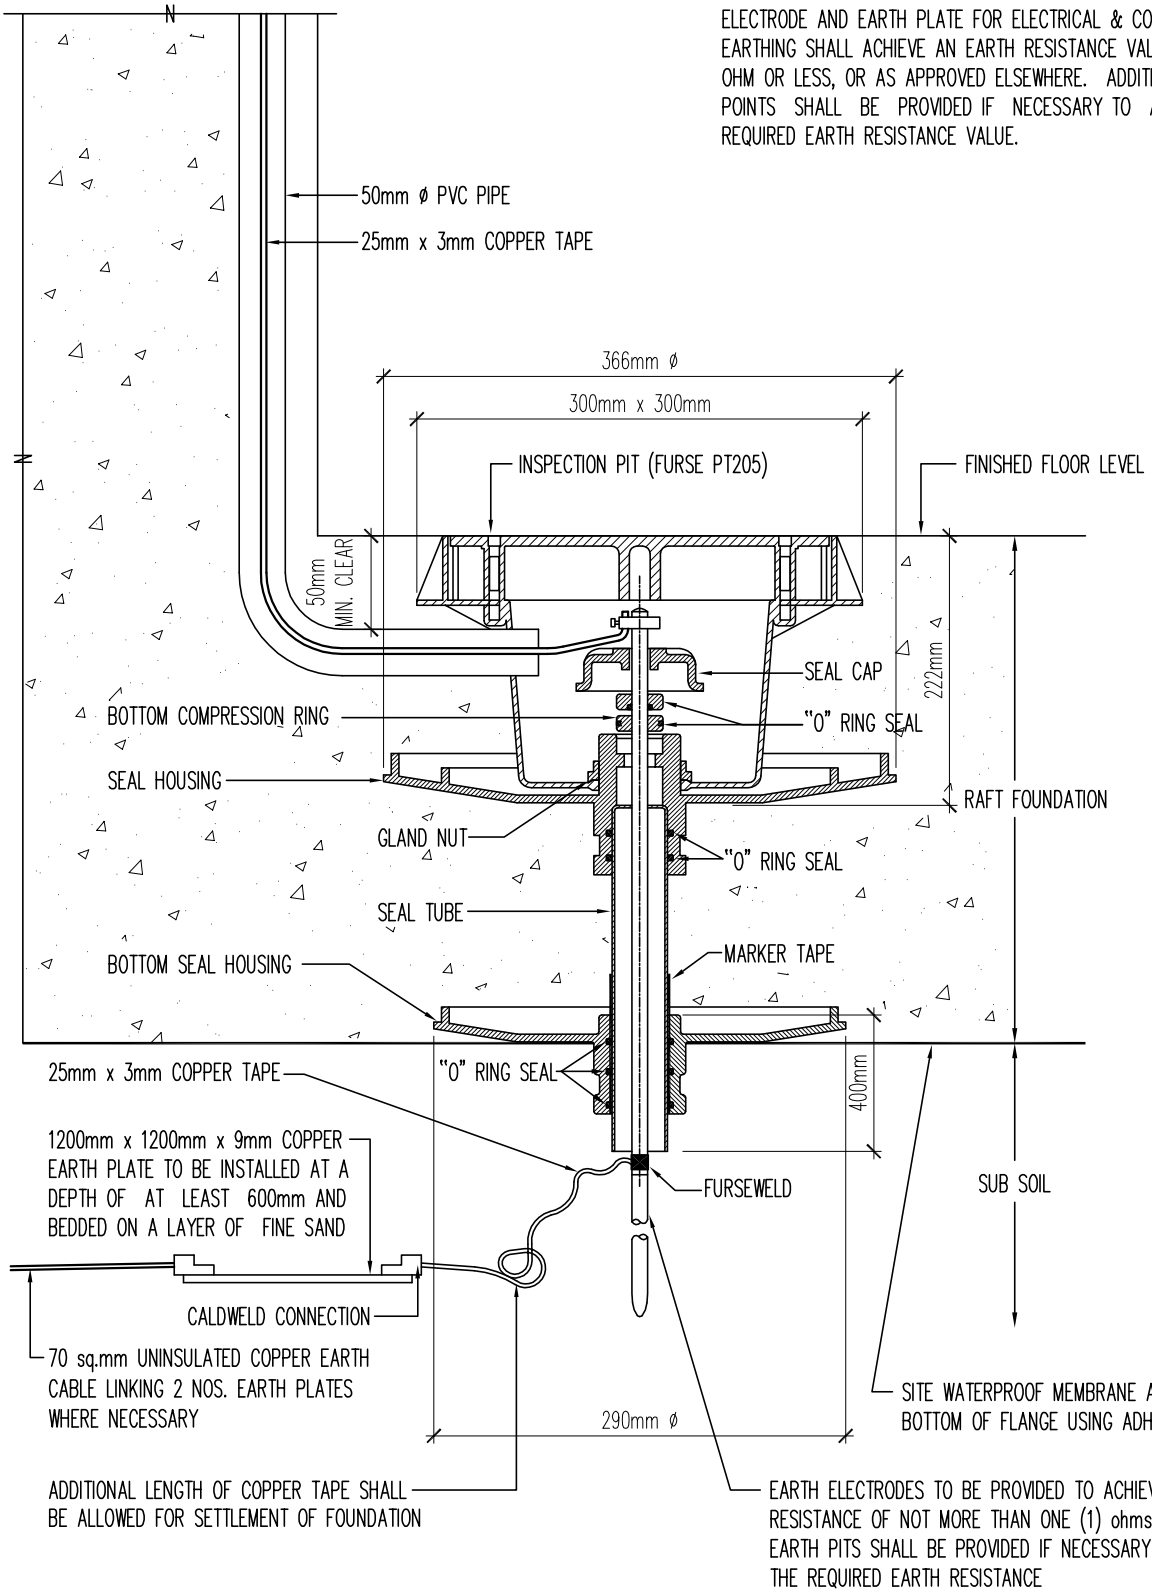

(THE ELECTRODE SEAL SHALL BE SIMILAR TO FURSE ES220)

Drawing Title

TYPICAL EARTHING POINT IN BASEMENT RAFT FOUNDATION (DOUBLE FLANGE TYPE ELECTRODE SEAL)

Alpha Consulting Engineers Pte Ltd	Drawing No. SE(LP) – 5	Rev. –