
NOTE

EACH EARTH POINT COMPRISING A COMBINATION OF EARTH ELECTRODE AND EARTH PLATE FOR ELECTRICAL & COMMUNICATION EARTHING SHALL ACHIEVE AN EARTH RESISTANCE VALUE OF ONE (1) OHM OR LESS, OR AS APPROVED ELSEWHERE. ADDITIONAL EARTH POINTS SHALL BE PROVIDED IF NECESSARY TO ACHIEVE THE REQUIRED EARTH RESISTANCE VALUE.

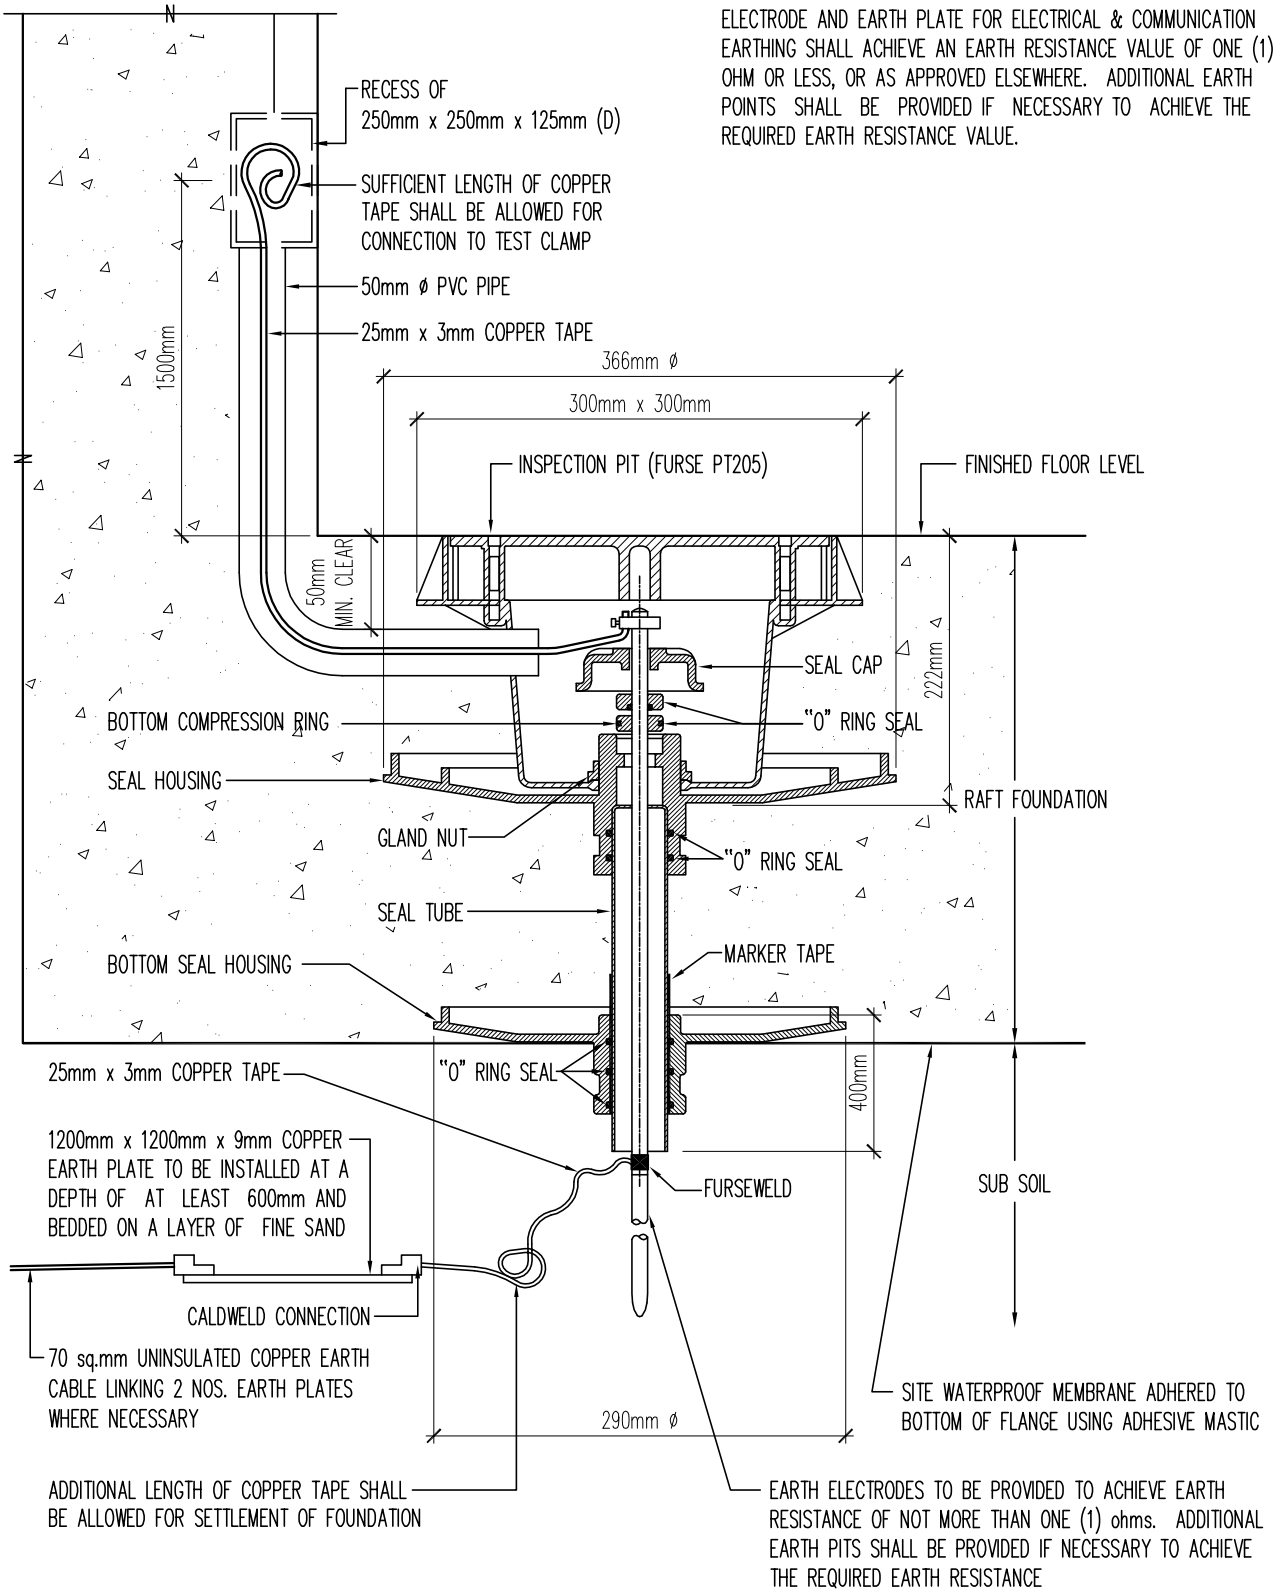

(THE ELECTRODE SEAL SHALL BE SIMILAR TO FURSE ES220)

Drawing Title: TYPICAL EARTHING POINT IN BASEMENT RAFT FOUNDATION (DOUBLE FLANGE TYPE ELECTRODE SEAL) (BY SUB-STRUCTURE CONTRACTOR)

Alpha Consulting Engineers Pte Ltd

Drawing No. SE(LP)-7

Rev. -