
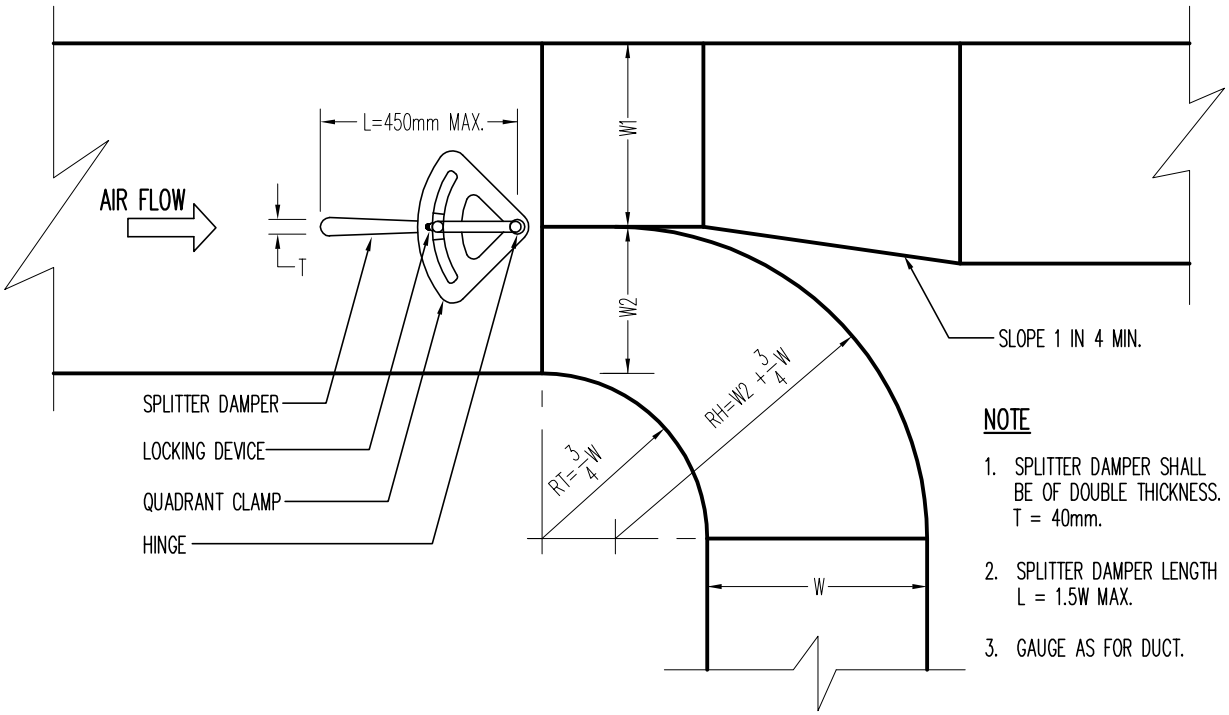


NOTE

1. SPLITTER DAMPER SHALL BE OF DOUBLE THICKNESS. T = 40mm.
2. SPLITTER DAMPER LENGTH L = 1.5W MAX.
3. GAUGE AS FOR DUCT.

MAIN BRANCH TAKE-OFF (VIEW FROM BELOW)

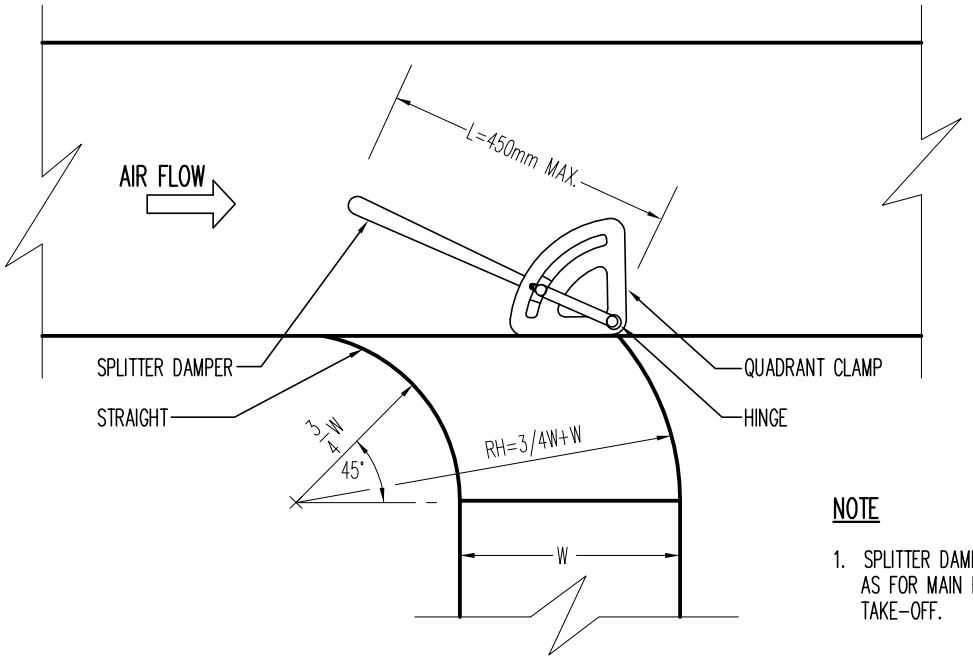

NOTE

1. SPLITTER DAMPER DETAIL AS FOR MAIN BRANCH TAKE-OFF.

SMALL BRANCH TAKE-OFF (VIEW FROM BELOW)

TITLE

TYPICAL DETAIL OF MAIN & SMALL BRANCH TAKE-OFF FOR DUCTWORK

Alpha Consulting Engineers Pte Ltd

DRAWING NO.

SM(DU) - 2

Filename: SMDU-2.dwg