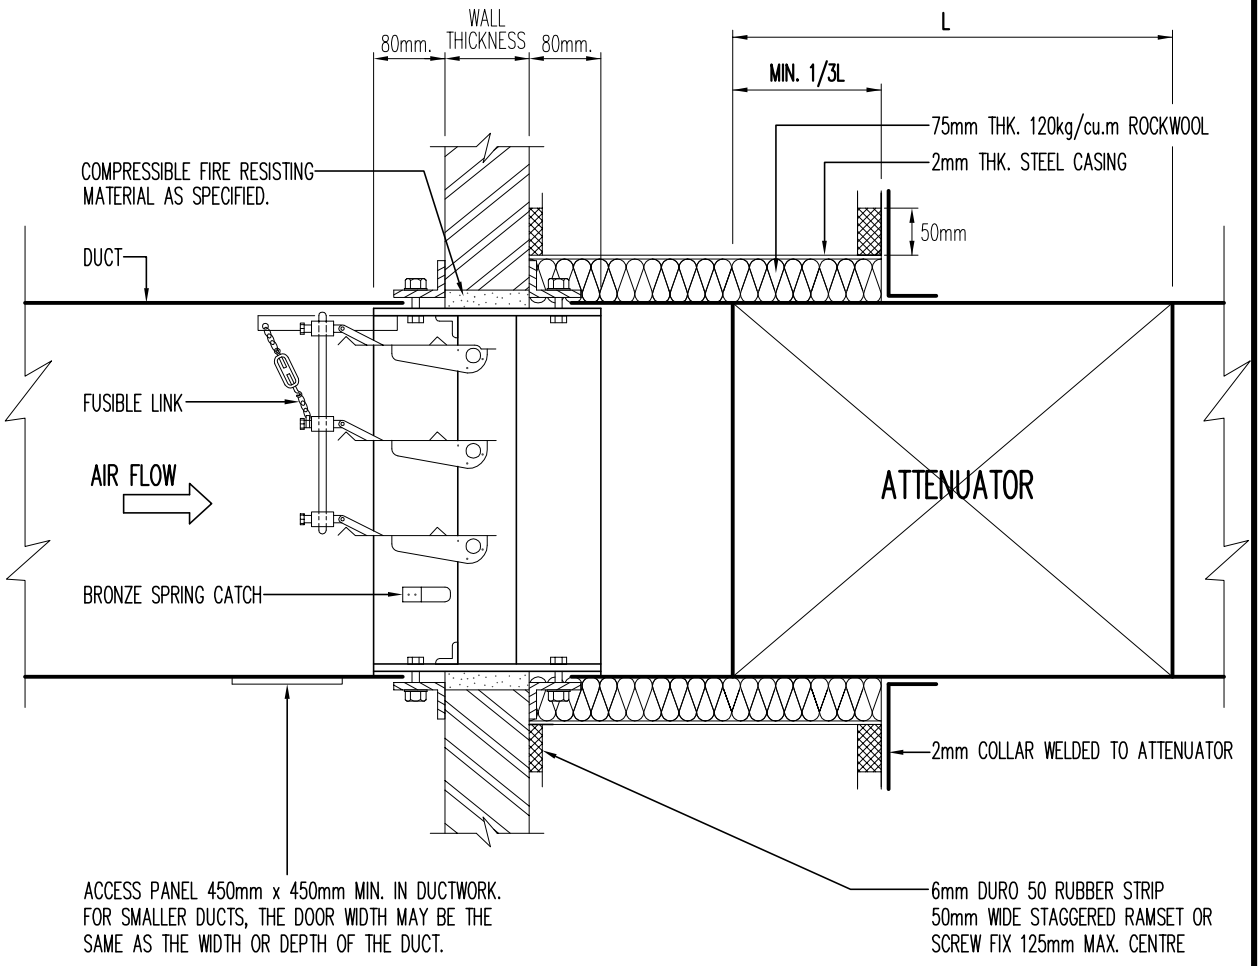


NOTE: CONNECTION OF DUCT TO FIRE DAMPER IS BY MEANS OF CLAMPING PRESSURE OF THE ANGLE IRON & THE FIRE DAMPER CASING. CONNECTION BY RIVET, SELF-TAPPING SCREWS, ETC. IS NOT ALLOWED.

TITLE

DETAIL OF TYPICAL WALL MOUNTED FIRE DAMPER WITH ATTENUATOR

Alpha Consulting Engineers Pte Ltd

DRAWING NO.

SM(DU) - 5

Filename: SMDU-5.dwg