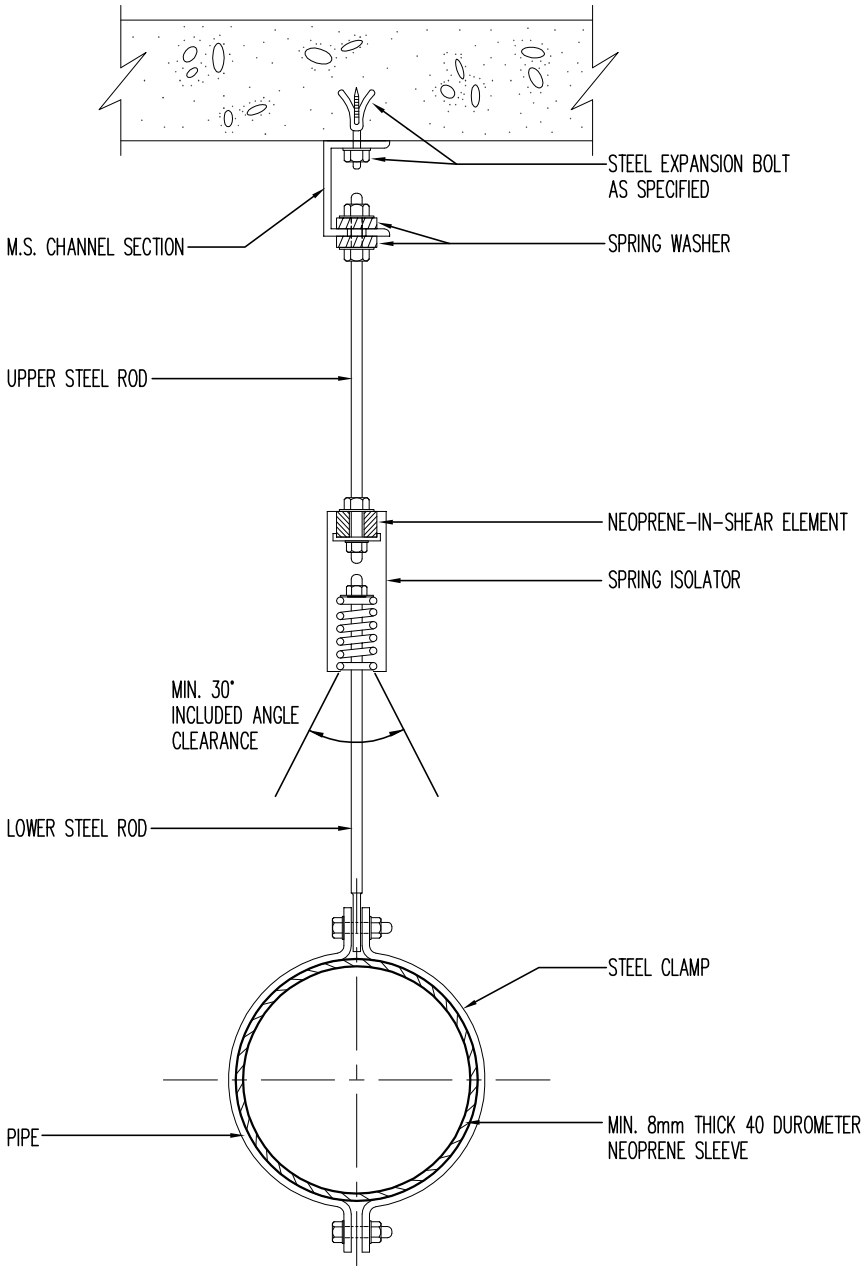


NOTES

1) NEOPRENE/SPRING HANGER SHOWN. WHERE NEOPRENE-IN-SHEAR HANGER IS SPECIFIED, SUBSTITUDE SPECIFIED UNIT FOR ISOLATOR.

2) WHERE NO VIBRATION ISOLATORS ARE SPECIFIED, RETAIN NEOPRENE SLEEVE UNLESS SPECIFIED OTHERWISE.

3) FOR CHILLED WATER PIPES, USE CALCIUM SILICATE SPACER TO MATCH SPECIFIED INSULATION THICKNESS. PLACE ONE LAYER NEOPRENE SLEEVE BETWEEN THE SPACER AND STEEL CLAMP AT EACH TYPICAL HANGER.

TITLE

TYPICAL ISOLATED PIPE HANGERS

Alpha Consulting Engineers Pte Ltd

DRAWING NO.

SM(PI) - 3

Filename: SMPI-3.dwg