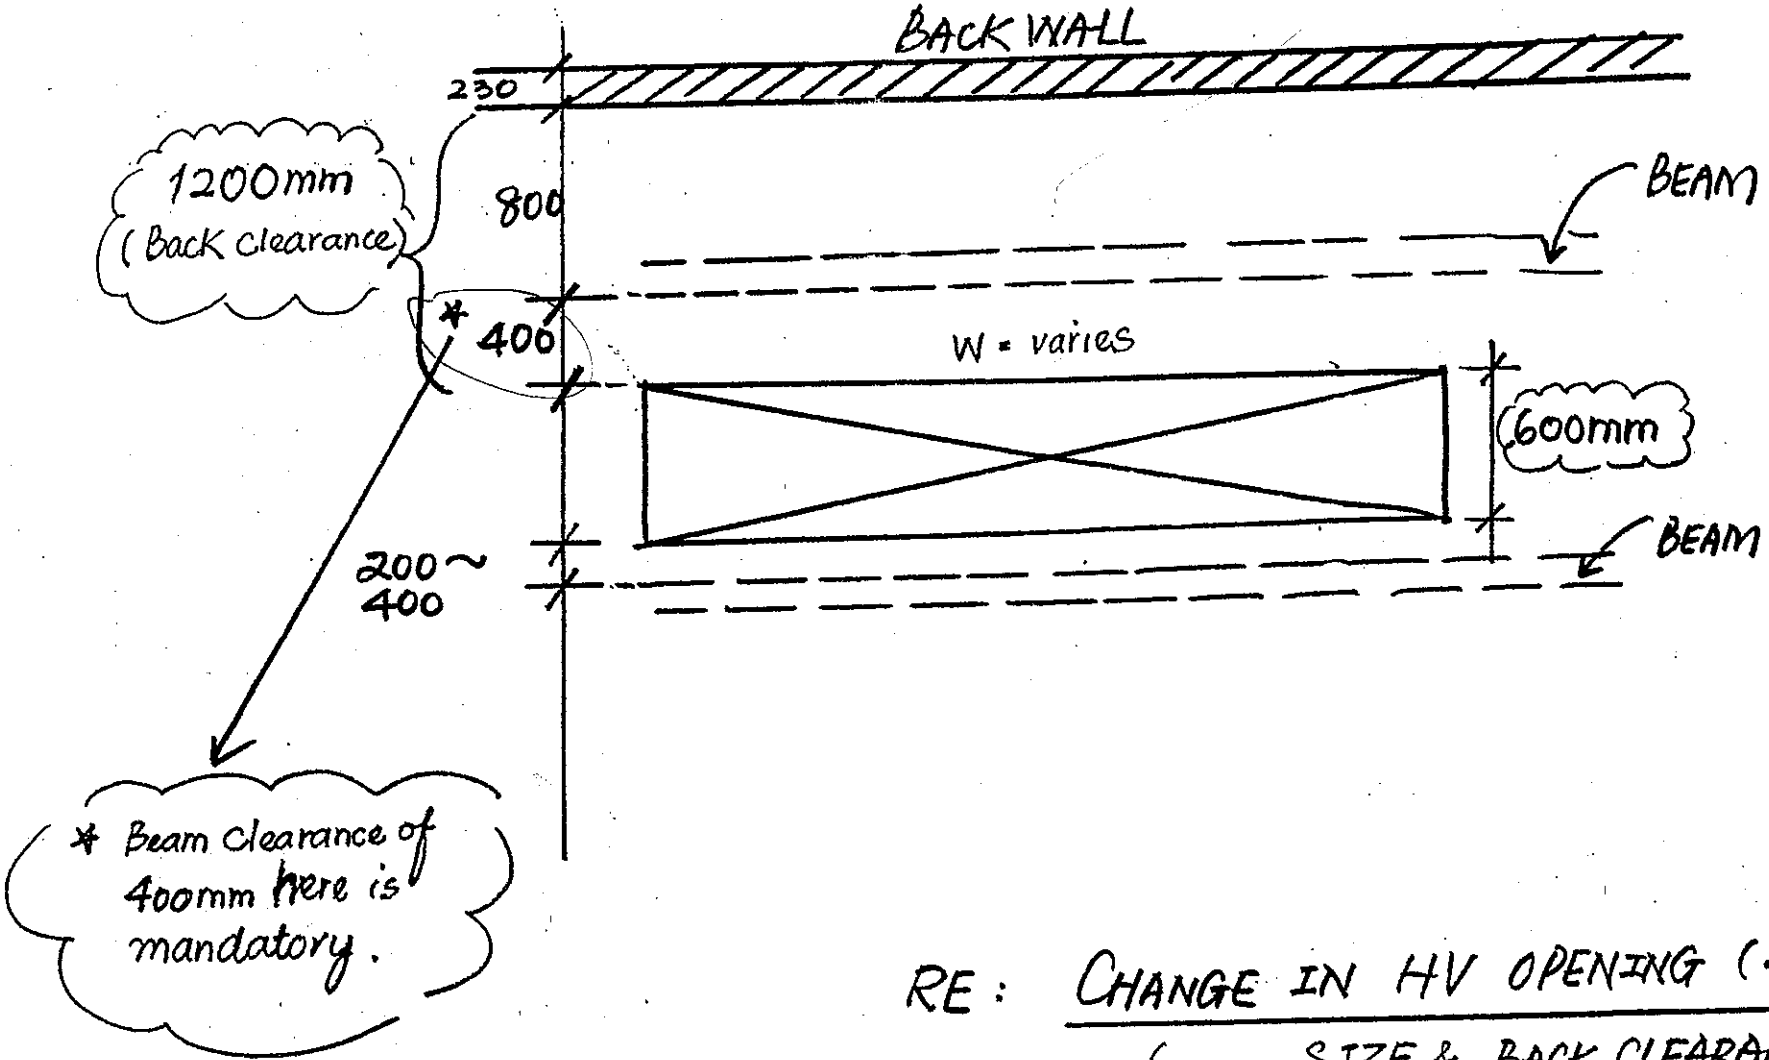


RE: CHANGE IN HV OPENING (22KV S/S)
(— SIZE & BACK CLEARANCE)

rec'd from Chin Yoke Fah - 19-1-01